




## ZI 20 Maximum Access Door Knobs Pressure

Testing Method: The knobs are tightened per hand as much as possible.

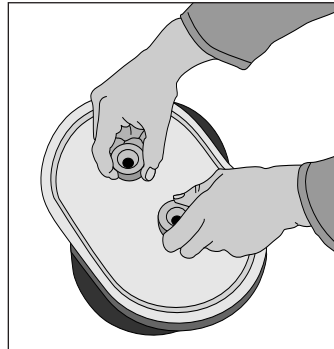

M8 Knob:	1000-1500 N or 737-1100 Pound-Force (Access Doors 18 and 21)
M10 Knob:	1200-1700 N or 1200-1700 Pound-Force (Access doors 315, 32, 42, 43 and 53)
M14 Knob:	2000-3000 N or 1475-3000 Pound-Force (Access Doors 54, 64, 65 and 75)

Indications about the minimum torque requirements to install the access doors correctly will soon become available.

### Disclaimer:

Every effort has been made to ensure that the information contained in this document is correct, but no warranty can be given in this respect and the company cannot be held liable as a result of any inaccuracy. The client and/or user has the obligation to make sure that the product is suitable for its individual case of application. Free translation: the original documents being in German, the English translation may contain some errors. Products and/or product specifications are subject to change without prior notice.